



BC Hydro Meter Communications

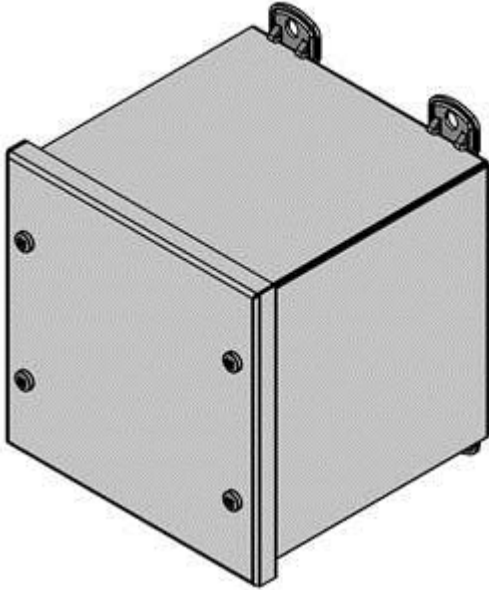

D-WP – S-060606

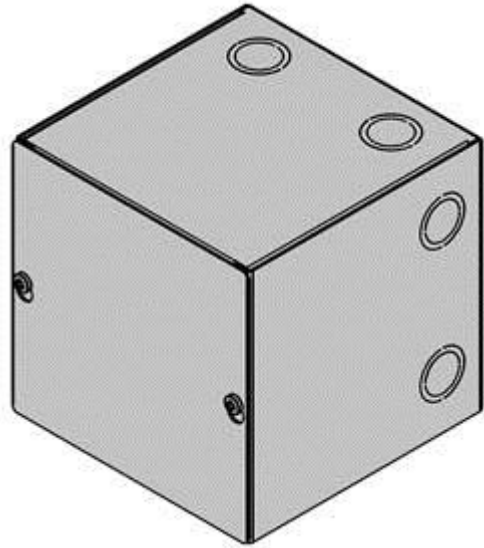

D-S-060606

Termination / Pull Boxes



- LOCAL INVENTORY
- BC Hydro Power Smart Information Bulletin
 - o Effective January 1, 2016
- PULL BOX TERMINATION required;
 - o Max length between termination box exceed 100m.
 - o Each end of the conduit will terminate in a 6x6x6 bonded enclosure
 - o Indoor and/or outdoor rated suitable for environment

- Thank you for choosing Code enclosures, cable tray and custom manufacturing



458 Nicola Place, Port Coquitlam, B.C., V3B 0K4
Phone: 604.540. 0011 Toll Free: 1.888.222.CODE Fax: 604.540.0033

sales@codeelectric.com www.codeelectric.com